


NOTE: ALL MANUAL ISOLATION VALVES
SUPPLIED BY OTHERS.

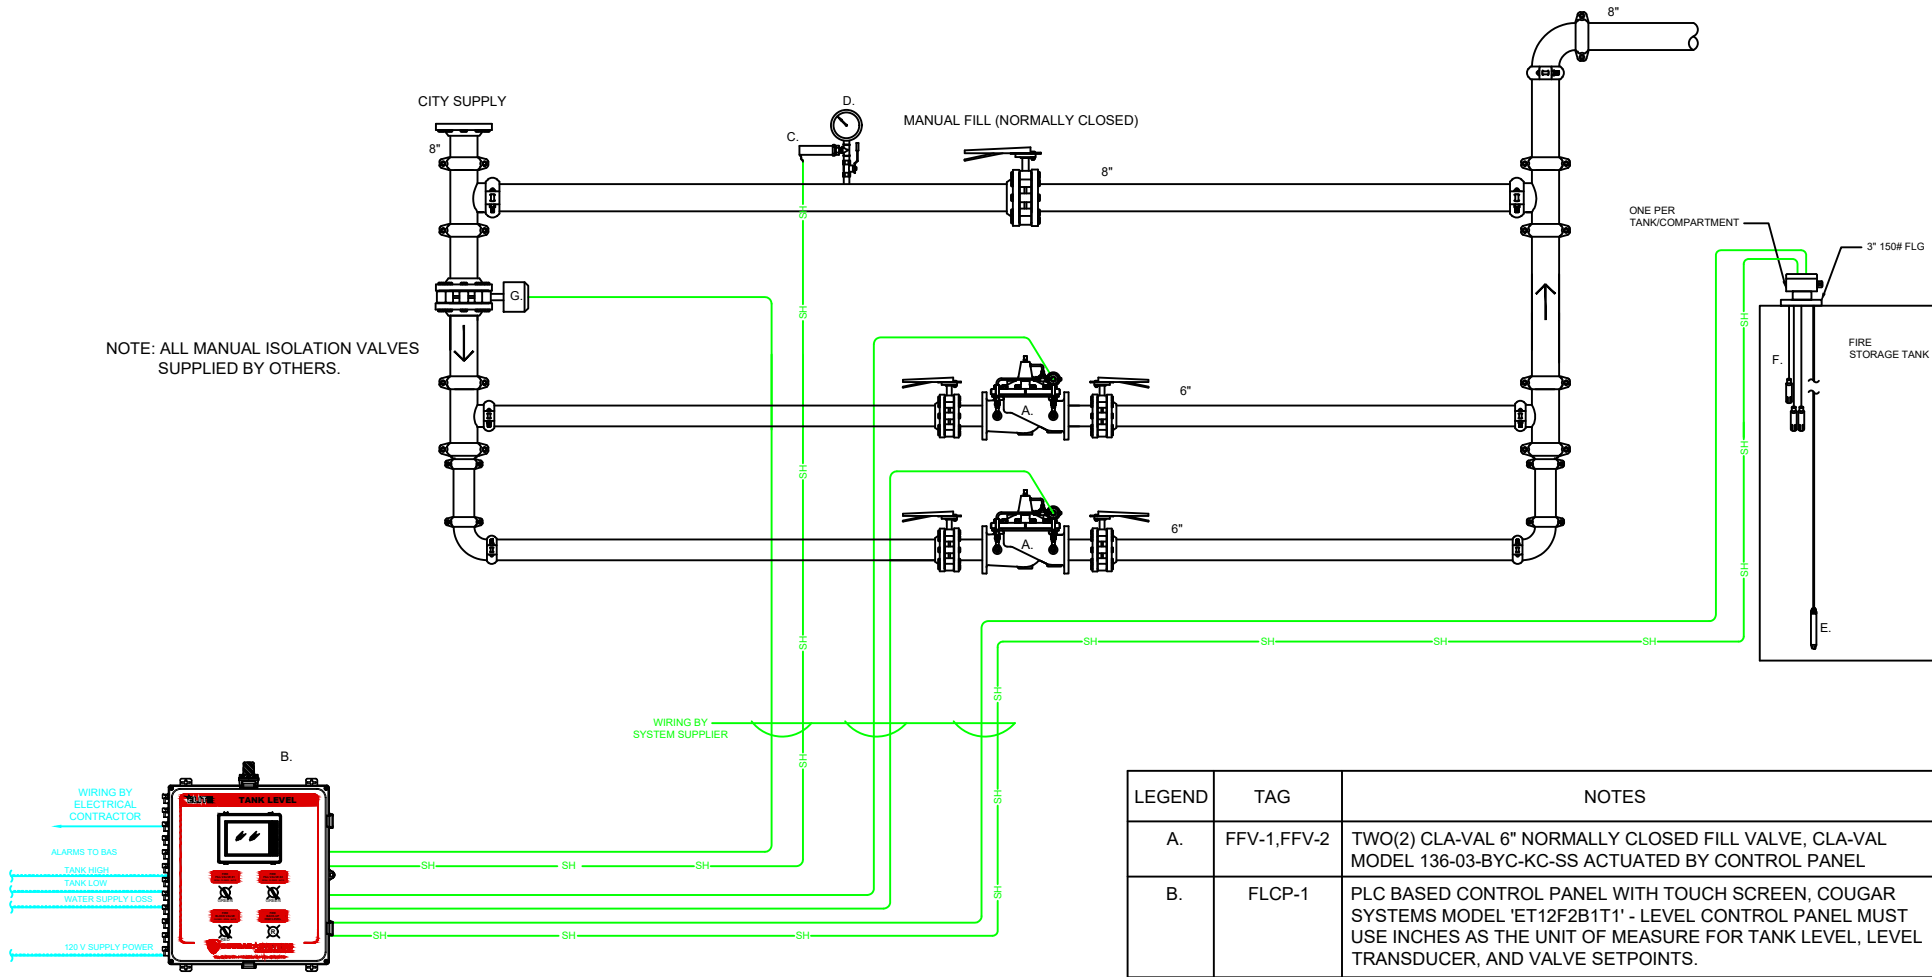

BLUE INDICATES "COORDINATE WITH OTHER DISCIPLINES"

INDICATES FIELD WIRING BY SYSTEM SUPPLIER

ALL RELATED LOCAL CONTROL WIRE & CONDUIT BY SYSTEM SUPPLIER TO
ENSURE A COMPLETE, COORDINATED AND FUNCTIONAL SYSTEM



Engineering Contact:
Michael Balboni
Direct: (713) 253-2320
Email: mbalboni@cougarusa.com

THIS DRAWING AND THE INFORMATION
CONTAINED HEREIN IS THE EXCLUSIVE
PROPERTY OF COUGAR SALES, INC.
AND SHALL NOT BE REPRODUCED
WITHOUT WRITTEN PERMISSION. THIS
DOCUMENT IS ISSUED SOLELY AS A
REFERENCE FILE. THIS DOCUMENT
SHALL NOT BE USED FOR PERMITTING,
BIDDING, OR CONSTRUCTION
PURPOSES.

Fire Water Storage
Tank Fill Station

ISSUE FOR ENGINEER APPROVAL / SUBMITTAL

Sheet No.

P-1